


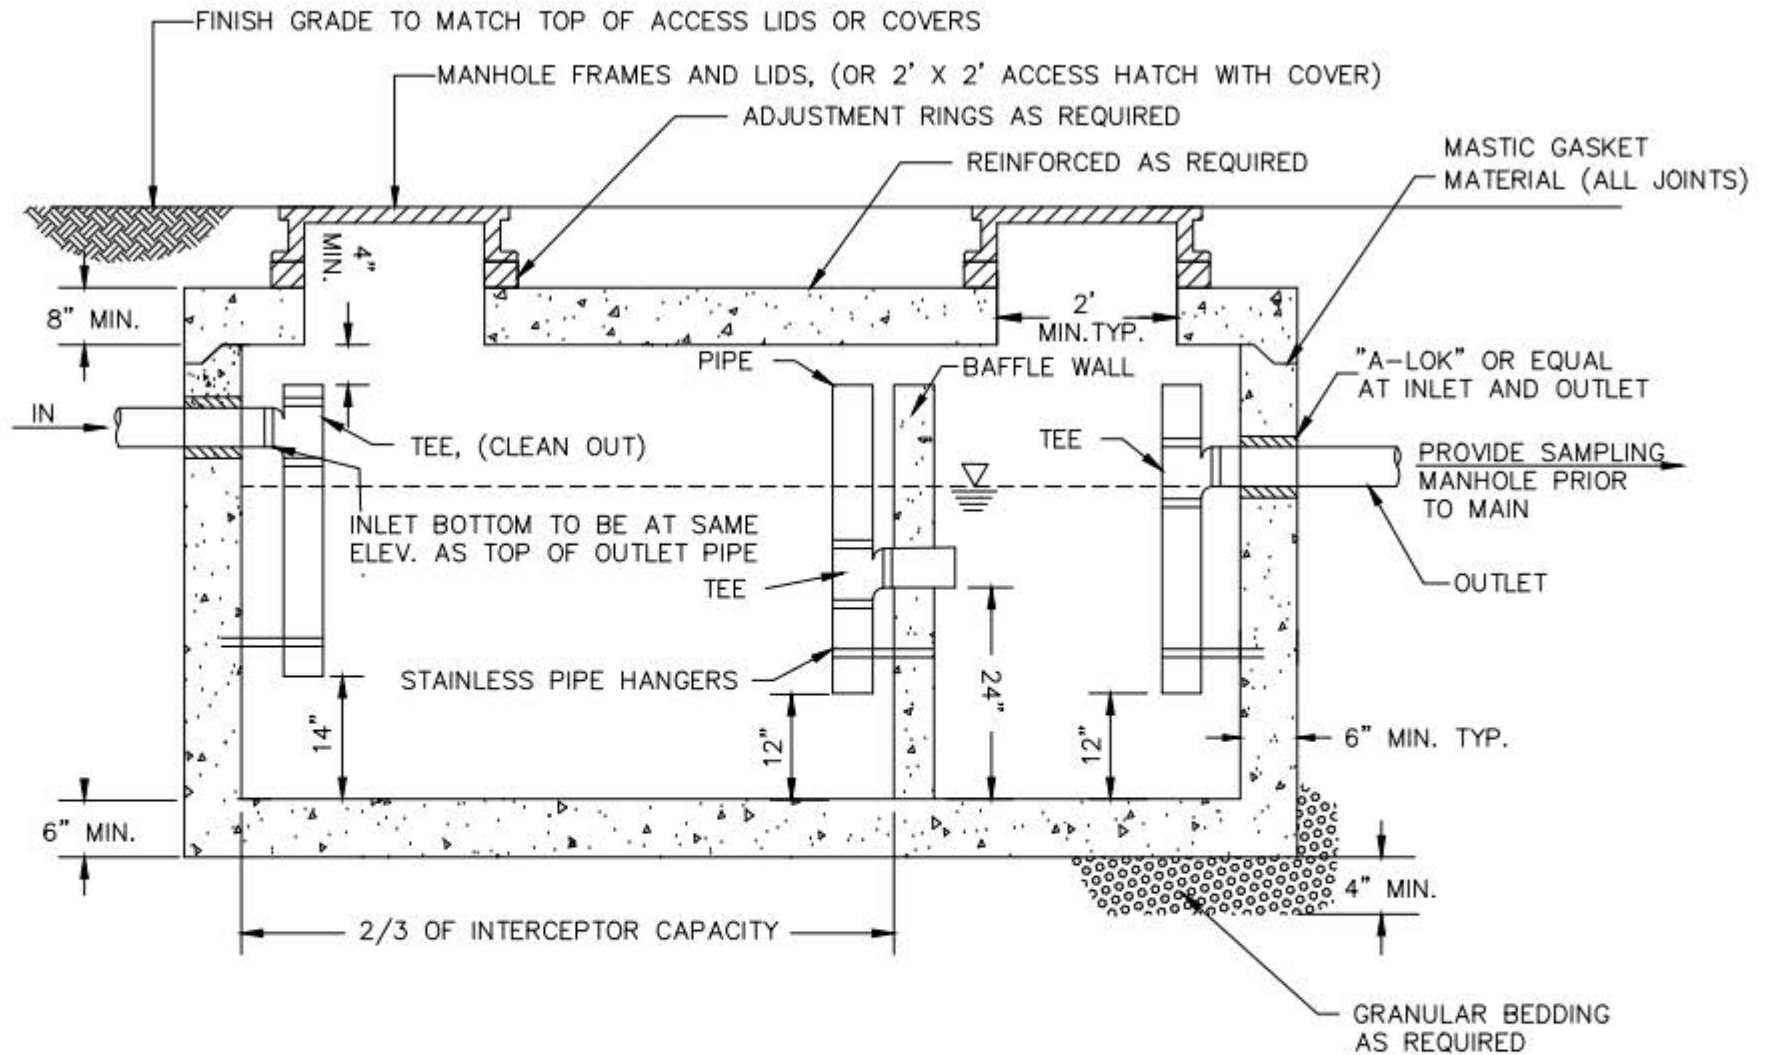

NOTES;

1. ALTERNATIVE CONFIGURATIONS OF GREASE INTERCEPTOR MAY BE SUBMITTED TO THE CITY FOR CONSIDERATION.
2. THE GREASE INTERCEPTOR SHALL BE ADEQUATELY SIZED TO ALLOW SUFFICIENT RETENTION TIME FOR SEPARATION AND SETTLING AS WELL AS SUFFICIENT STORAGE CAPACITY.
3. PROVIDE APPROPRIATE LIFT ANCHORS.
4. IF THE INLET AND OUTLET CLEAN OUT TEES ARE NOT READILY ACCESSIBLE FROM THE HATCHES, THEN CLEAN OUTS SHALL BE PROVIDED ON THE INLET AND OUTLET PIPES OUTSIDE OF THE INTERCEPTOR.
5. THE LIQUID DEPTH SHALL BE 72 INCHES MAXIMUM.
6. THE TANK LENGTH SHALL BE GREATER THAN THE TANK WIDTH.
7. REFER TO ASTM C 1613, STANDARD SPECIFICATIONS FOR PRECAST CONCRETE GREASE INTERCEPTOR TANKS.
8. TANKS SHALL BE CONSTRUCTED IN ACCORDANCE WITH ASTM C890, STANDARD PRACTICE FOR MINIMUM STRUCTURAL DESIGN LOADING.
9. TANK AND ALL APPURTENANCES TO BE FABRICATED AND ASSEMBLED AT MANUFACTURING PLANT.